


iGuard™ Connectors Quick Notes

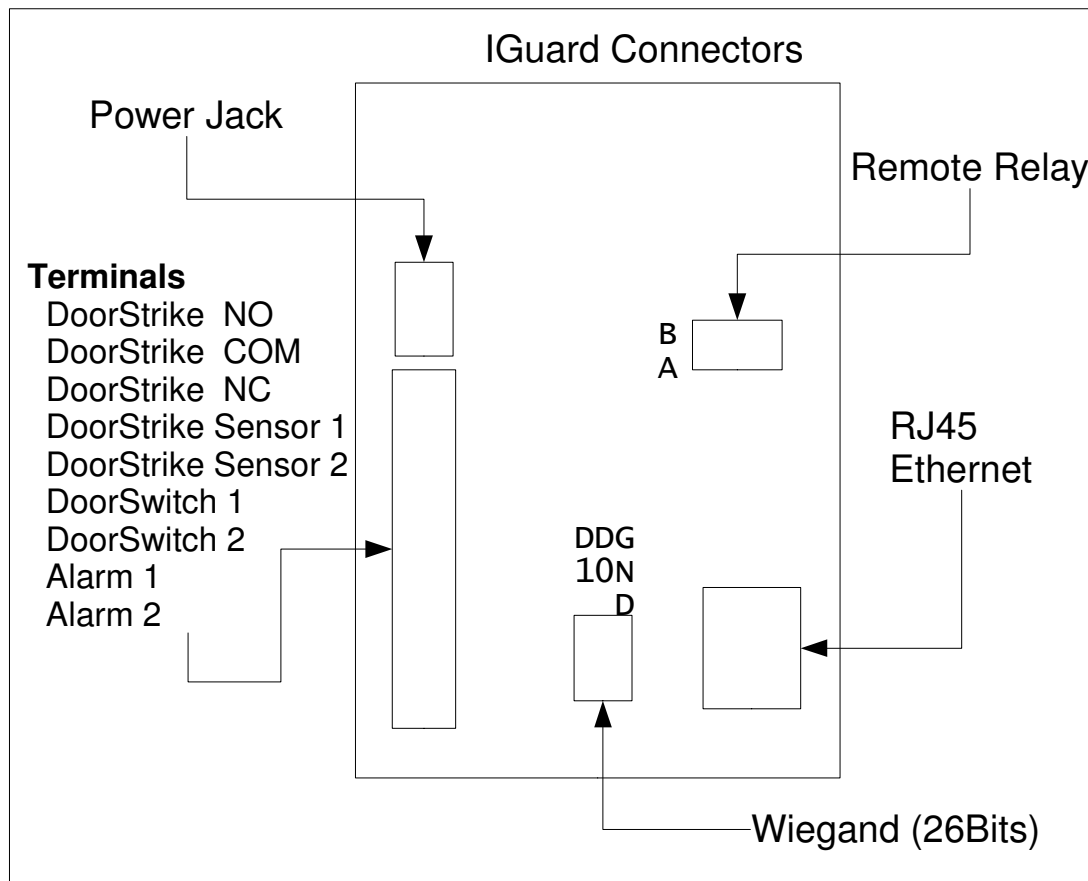

Quick Notes iGuard Connectors

Power Jack	- Connect to the Power Adaptor (12VDC)
Wiegand Output	- Wiegand output (26bits)
Remote Relay Door Relay)	- Connect to iGuard Remote Relay Module (see application notes for Remote
RJ45 Ethernet	- Connect to your Ethernet Network
Terminals	
DoorStrike NO	- "Normal Open" of Built-In Door Strike Relay
DoorStrike COM	- "Common" of Built-In Door Strike Relay
DoorStrike NC	- "Normal Close" of Built-In Door Strike Relay
DoorStrike Sensor 1	- Connect to DoorStrike's door open sensor (optional)
DoorStrike Sensor 2	- Connect to DoorStrike's door open sensor (optional)
DoorSwitch 1	- Connect to Door Open Switch (optional)
DoorSwitch 2	- Connect to Door Open Switch (optional)
Alarm 1	- iGuard Case Open Alarm output
Alarm 2	- iGuard Case Open Alarm output

Requirement:

In order to use all the function, special requirement of iGuard is necessary, which is the Firmware Version : 3.4.0001A or up (can be updated by firmware update patch). For info, please visit our home page : www.lucky-tech.com